




sales@mmhpindia.com

+91 9321570843

AUTHORIZED BUSINESS ASSOCIATE







Purge Economiser - Reduces purge loss and energy according to load requirements.

Accepts dewpoint meter signal to cycle on dewpoint temperature instead of time.

- Designed For ISO:7183-1986 (E)
- Dryer Quality Class ISO: 8573-1: 2010 (E) class 3 (-40 ADP)
- Pressure Drop < 0.3 kg/cm² (g)
- Fabrication Code: IS 2825 / ASME SEC VIII Optional
- LCD Display
- Stainless Steel Internals
- Filter made of aluminium with differential pressure indicator
- Operating voltage: 100 253 VAC 50+5% Hz 1 Ph.





Compressed Air Dryers (Heatless)

DP V2 Series



AUTHORIZED BUSINESS ASSOCIATE OF TRIDENT PNEUMATICS PVT. LTD.

Selection Example

Requirement :

Flow Volume : 480 cfmWorking Pressure : $10 \text{ Kg} / \text{cm}^2$

Inlet air Temperature : 50°c

Referring the Graphs : Factor (T) = 0.74

Factor (P) = 1.4

Dryer capacity required:

Flow volume 480

= 463 cfm

Factor (T) x Factor (P) 0.74 x 1.4

Choose the nearest higher model i.e, Model DP-960V2

Model	Item Code	Inlet Flow cfm	End Connection	Dimensions (mm)			Weight
				Height	Width	Depth	Kg
DP-768V2	PD328	450	2" NB	1750	1320	850	850
DP-960V2	PD329	565	2" NB	1730	1430	850	950
DP-1440V2	PD330	850	3" NB	1865	1930	1000	1265
DP-1920V2	PD331	1130	3" NB	1990	1930	1000	1575

- For any other capacity contact factory.
- Specifications are subject to change without notification.

Specification

Maximum Operating Pressure: 12.5 kg/cm² (g)

Air Inlet Temperature : 45 °C

Operating pressure : 7 kg/cm² (g)

Pre - Filter Rating : 5 Micron

After - Filter Rating : 1 Micron

Cycle Time : 10 Minutes


Purge Loss : $12 \pm 1\%$

Outlet Conditions : -40°C ADP


Principle of Operation

Drying Cycle: Moist air from the compressor is sent through the coalescing filter. Here water & oil coalesces and purges through the auto drain valve. The relatively clean air with water vapour passing through the aluminum drying tower filled with desiccant gets completely dried (up to -40°C ADP) and then passes through a built in after filter (1 micron). The desiccant fines from the towers are completely removed and clean dry air is let out through the outlet port for use.


Regeneration Cycle: During the regeneration cycle, the sudden depressurisation brings out water molecule strapped in the Desiccant pores to the surface of the beads. A small portion of dry compressed air from the drying tower then passes over the desiccant through the regeneration orifice built in the Top Block. This results in complete regeneration of the Desiccant.

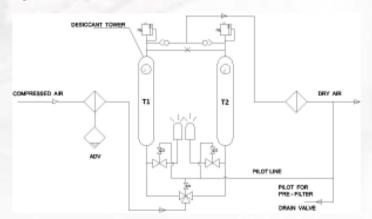

Inlet Temperature Correction Factor

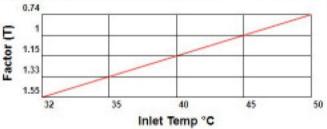

Inlet Pressure Correction Factor

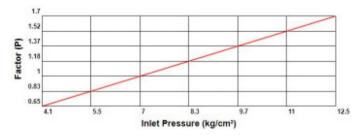



Our Other Range of Products

• Timer based Auto Drain Valve • Level Sensing Auto Drain Valve • Desiccant Dryer (Heated) • Refrigeration Dryers

Water Separator
Submicron Filter







ADDRESS:

M M Hydro Pneumatics Pvt Ltd Unit No. 101, Kanchan Ind Premises, Samhita International Complex, Sakinaka, Andheri (East), Mumbai- 400072.

